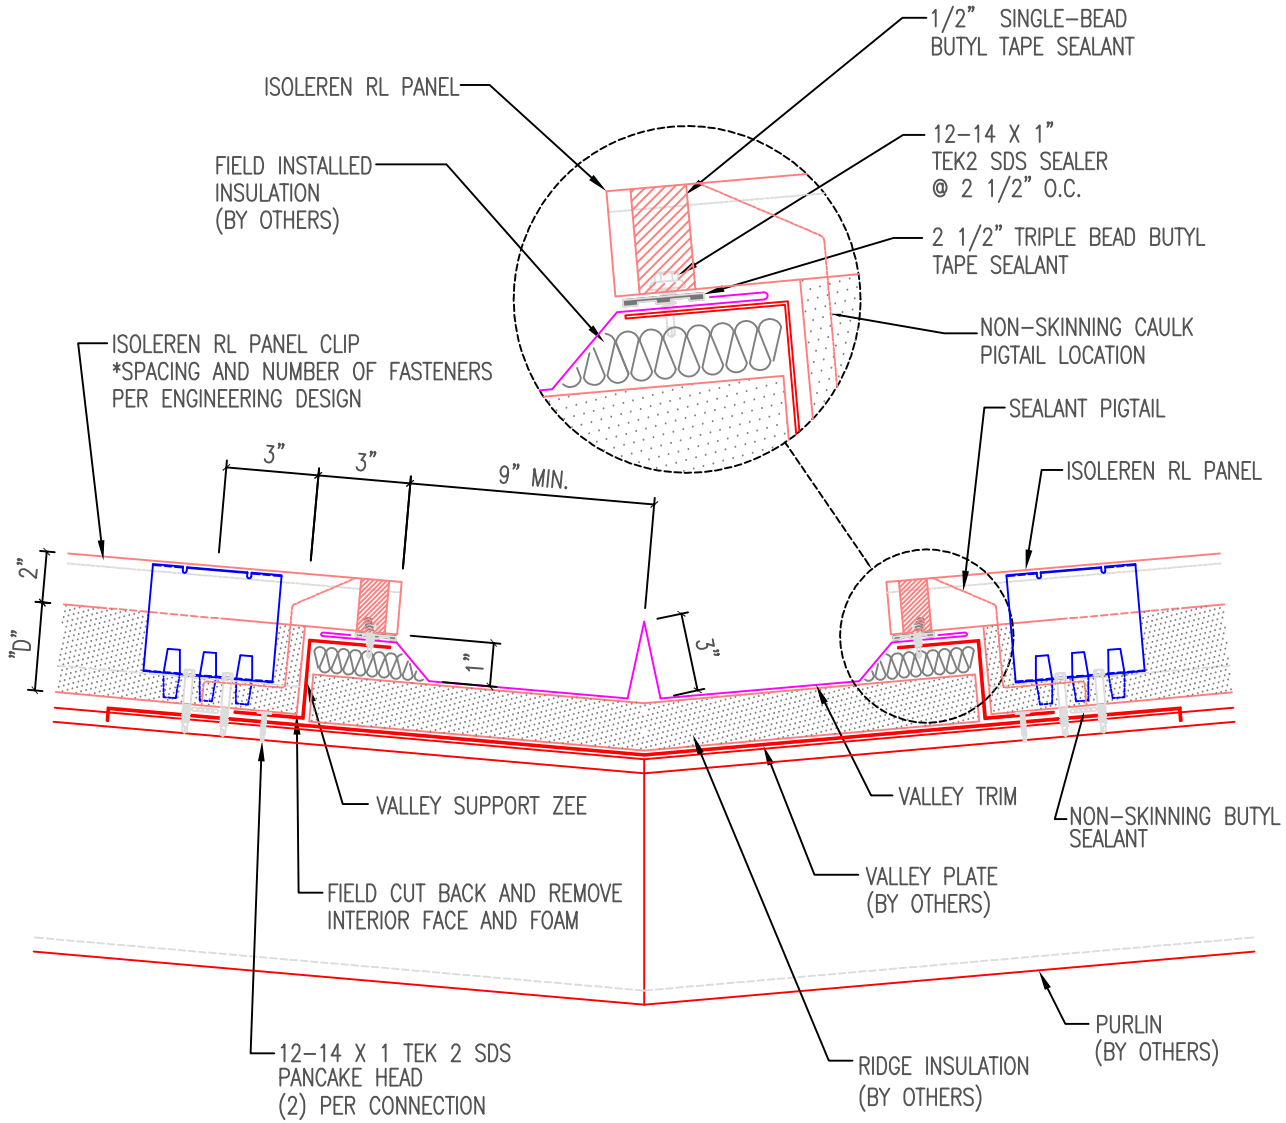

NOTES:

1. "D" = ROOF PANEL THICKNESS (AVAILABLE THICKNESS = 2.5, 3, 4, 5, OR 6)
2. FILLER INSULATION MATERIAL AND APPLICATION IS SPECIFIED BY THE PROJECT DESIGNER.
3. VALLEY CONDITIONS ARE NOT RECOMMENDED FOR APPLICATIONS WITH ROOF PITCH LESS THAN 3:12.
4. THE VALLEY PAN WIDTH VARIES WITH THE ROOF'S DRAINAGE REQUIREMENTS.
5. RECOMMENDED VALLEY PAN IS 16 GA. MIN. STEEL, WELDED WATER-TIGHT AND COATED OR LINED WITH MEMBRANE.

** THE DETAIL SHOWN IS SUBJECT TO CHANGE WITHOUT NOTICE.

REV. NO.	DATE	DESCRIPTION OF REVISION	BY	APP

ATAS INTERNATIONAL, INC
Allentown PA
610-395-8445
Mesa AZ
480-558-7210

TITLE	Roof-Valley		
DWG. NO.		DR	DATE 8/2/2016
		APP	DATE
MATERIAL		SH. SIZE	SCALE X:X